


NOTE: Must have Permanent Health Dept. sticker

UTILITY SERVICE DROP

10" MIN

CLEARANCES

- ① 12 FT. MINIMUM ABOVE WALKS
18 FT. MINIMUM ABOVE PUBLIC STREETS, ALLEYS AND CLTIVATED OR GRAZING AREAS.
- ② POINT OF ATTACHMENT SHOULD NOT BE FARTHER THAN 2 FEET FROM THE WEATHERHEAD AND INSTALLED BY THE ELECTRICIAN TO ATTACH UTILITY SERVICE DROP.

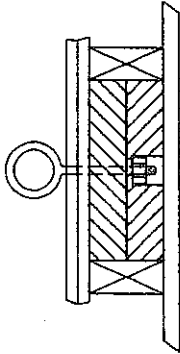

- ③ MINIMUM CONDUIT SIZE
SEE TABLES 8-C, 8-E, 8-F

FOR SINGLE FAMILY DWELLINGS ONLY				
AMP	COPPER	CONDUIT	ALUM.	CONDUIT
100	#4	1 1/4"	#2	1 1/4"
200	#2 / 0	1 1/2"	#4 / 0	2"

IF PVC IS USED, MUST BE SCHEDULE 80

- ④ GROUNDING ELECTRODE CONDUCTORS SHALL BE UNSPLICED AND HAVE 6" EXPOSED FOR THE INTERCONNECTION OF OTHER SYSTEMS. ELECTRICAL NONMETALLIC OR METAL CONDUIT SHALL BE USED FOR PROTECTION. IF METALLIC BOND BOTH ENDS (SEE SECTION 4-1 & 3)

12'-0" MINIMUM FINAL GRADE TO ATTACHMENT

5'-0" MIN

6'-0" MAX

FINAL GRADE

12" MIN

24" MIN

TWO APPROVED 8" DRIVEN GROUND RODS WITH ONE PIECE CLAMPS REQUIRED ON ALL SERVICES, 6' APART.

